

Introduction to PowerWorld Simulator: Interface and Common Tools



I11: Linear Sensitivity Analysis



PowerWorld
Corporation

2001 South First Street
Champaign, Illinois 61820
+1 (217) 384.6330

support@powerworld.com
<http://www.powerworld.com>

Linear Analysis




- Power Transfer Distribution Factors (PTDFs)
- Shift Factors
- Multiple Direction PTDFs
- Multi-Element Shift Factors
- Line Outage Distribution Factors (LODFs)
- Outage Transfer Distribution Factors (OTDFs)
- Flow and Voltage Sensitivities
 - Line Flows, Interface Flows, Bus Voltages, Losses
- Loss Sensitivities
- Line Loading Replicator
- Connections Menu

Power Transfer Distribution Factors (PTDFs)



- PTDF is a term defined by NERC to indicate the incremental impact a transfer of power between areas has on system flows.
- PTDFs can be calculated in Simulator by selecting **Tools** ribbon tab → **Sensitivities** → **Power Transfer Distribution Factors (PTDFs)**.
- PTDFs can be visualized on the onelines.



Power Transfer Distribution Factors (PTDFs)...

Shift Factors...

Line Outage Distribution Factors (LODFs)...

Flow and Voltage Sensitivities...

Loss Sensitivities...

LODF Screening...

Driving Point Impedances...

PTDF Calculation



- PTDFs show the linear impact of a power transfer
 - They show what percent of a transfer would appear on each transmission line in the power system
- PTDFs calculated using the factored power flow Jacobian
 - $\Delta \mathbf{x} = [\mathbf{J}(\mathbf{x}^*)]^{-1} \Delta \mathbf{P}$
 - $\Delta \mathbf{P}$ = change in power injections associated with power transfer
 - $\Delta \mathbf{x}$ = change in system voltages and angles, which are used to calculate flows

Specifying Transfer Direction for PTDF Calculation



- Must specify a buyer (sink) and a seller (source) of power – a transfer direction
- Options for Buyer and Seller
 - Area, Zone, or Super Area
 - The PTDF calculation will assume that the generators in this region participate according to their participation factors
 - Slack
 - Means all power will come from or go to the slack bus
 - Injection Group
 - Injection groups can include loads and/or generation. Participation is specified for each element of the group
 - Bus
 - All power will come from or go to this bus.

Calculation Method for PTDF Calculation




- Must specify a calculation method
 - Linearized AC – includes the full Jacobian in the calculation, and thus includes losses
 - Note: the PTDF calculation assumes that all losses are made up for by the buyer
 - Exception: if the seller contains the slack bus, then the seller will make up for all losses.
 - Lossless DC – only uses the DC power flow equations, so losses not included
 - Lossless DC with phase shifters – modification to previous that forces change in flow across operating phase shifters to be zero.

Lossless DC with Phase Shifters



- Phase Shifters are often used on lower voltage paths (230 kV or less) with relatively small limits
 - They manage flow on a path that may otherwise see overloads
 - Thus, they constantly show up as “overloaded” when using linear analysis if they are not accounted for
- Example: Border of Canada with Northwestern United States
 - PTDFs between Canada and US without Phase-Shifters
 - 85% on 500 kV Path
 - 15% on Eastern Path
 - PTDF With Phase-Shifters
 - 100% goes on 500 kV Path
 - 0% on Eastern Path

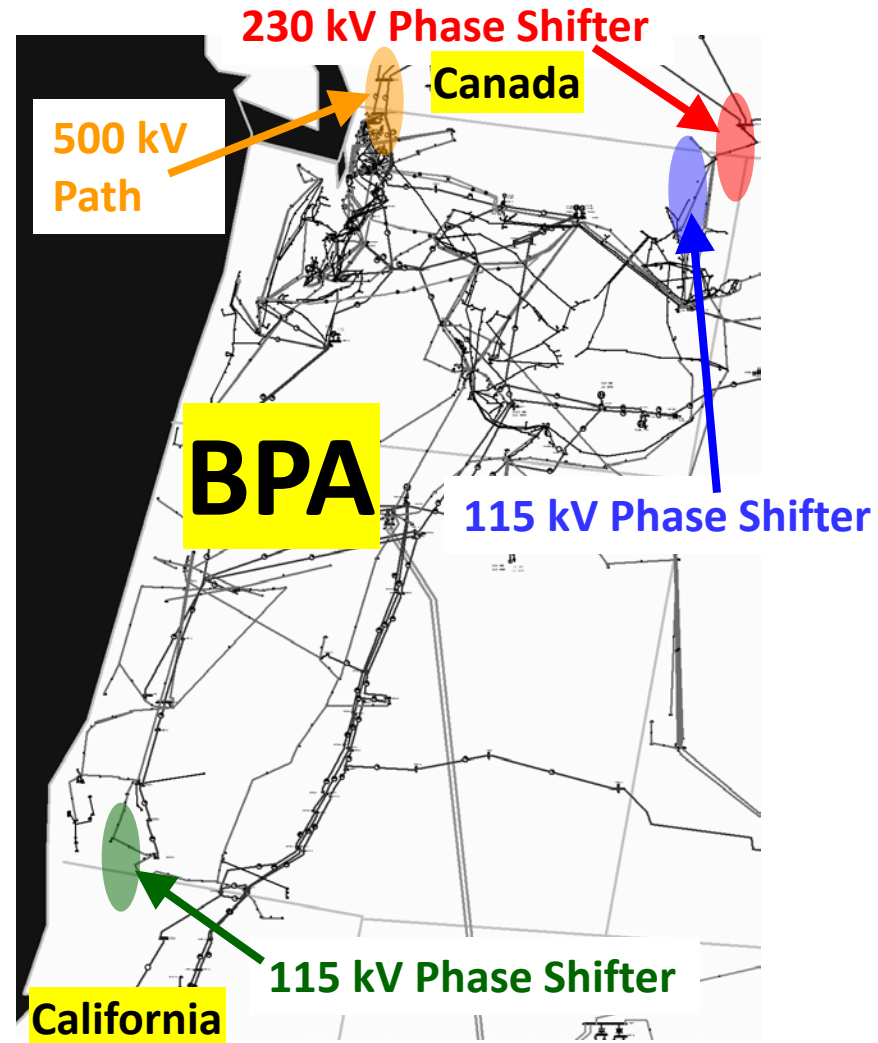

PTDF Display



- Choose **Tools** ribbon tab → **Sensitivities** → **Power Transfer Distribution Factors (PTDFs)**

Select Calculation Method

Select to calculate the PTDFs

Percentage change in system losses

Choose seller and buyer

Switches buyer and seller

Visualize PTDFs on online. Available if exactly one oneline is open.


Results expressed as a percentage of the power transfer at the margin

	From Number	From Name	To Number	To Name	Circuit	% PTDF From	% PTDF To	% I
1	1	One	2	Two	1	-2.10	2.10	
2	1	One	3	Three	1	2.10	-2.10	
3	2	Two	3	Three	1	3.49	-3.49	
4	2	Two	4	Four	1	4.42	-4.42	
5	2	Two	5	Five	1	26.66	-26.66	
6	2	Two	6	Six	1	-36.67	36.67	
7	3	Three	4	Four	1	5.59	-5.59	

PTDFs on the Onelines



Animated arrows indicate percentage of transfer flowing on the interface. A different color may be used to highlight counter-flows

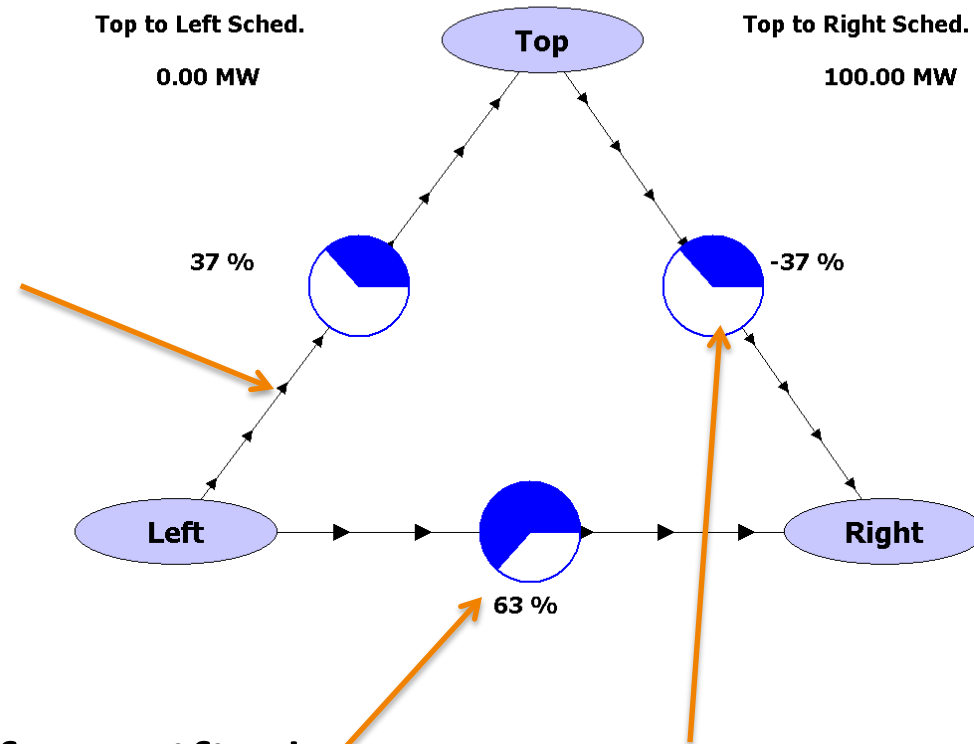



Fields now show percentage of specified transaction flowing through the interface

Pie chart fill also indicates PTDF%

PTDFs on the Onelines



Using the Oneline Display Options dialog, the size/color of the pie charts (both line and interface) can be conditional, based upon percentage flow through the device

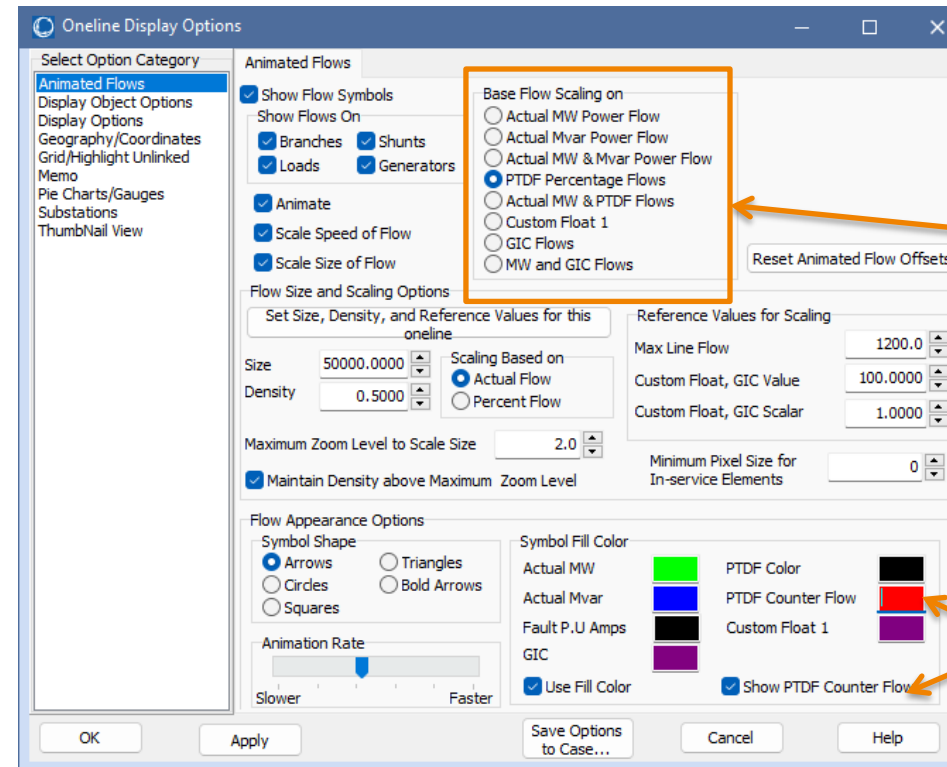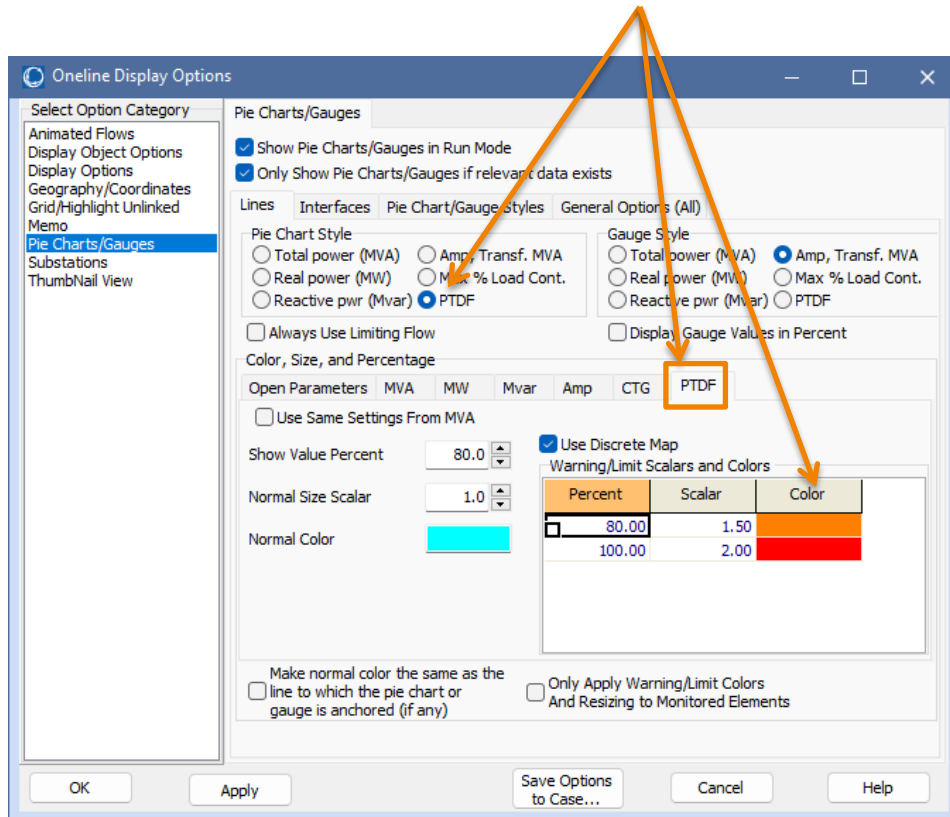

Use to toggle between actual flows and PTDFs (you can also use the online local-menu.)

Optionally apply different color to counterflow

PTDF: MW*Distance

- PTDF results can be used with transmission line lengths to compute the sum of MW*Distance over branches within each Area and Zone for the given PTDF buyer/seller pair.

Length can come from individual line records or Ohm/length estimates by nominal kV

MW * Distance Calculations

Line Length Assumptions

Load Line Lengths From File ... ☐ Do not use length estimates ☒ Always estimate length ☐ Save estimates with case

Simulator must estimate the lengths of lines whose lengths are not provided. Use the table below to specify the values.

kV	138.0								
Ohms/Length	0.25								

Results

Source: Left (2)
Sink: Right (3)
Size (MW): 1

Calculate

Options ... OK Cancel Help

Areas Zones


	Area Num	Area Name	MW*Distance
1	1	Top	76.353
2	2	Left	115.780
3	3	Right	16.760




Remember:

Pie Charts Options Toolbar

- Available in **Options** ribbon tab → **Pie Chart**
- Notice that all the settings on the dialog are available

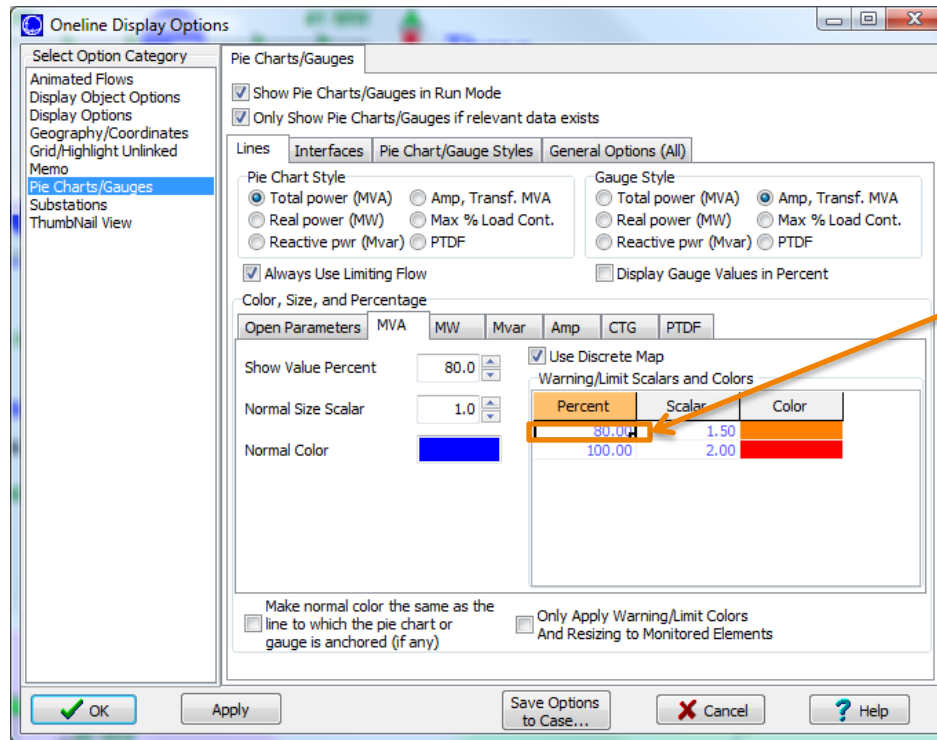


Same Setting

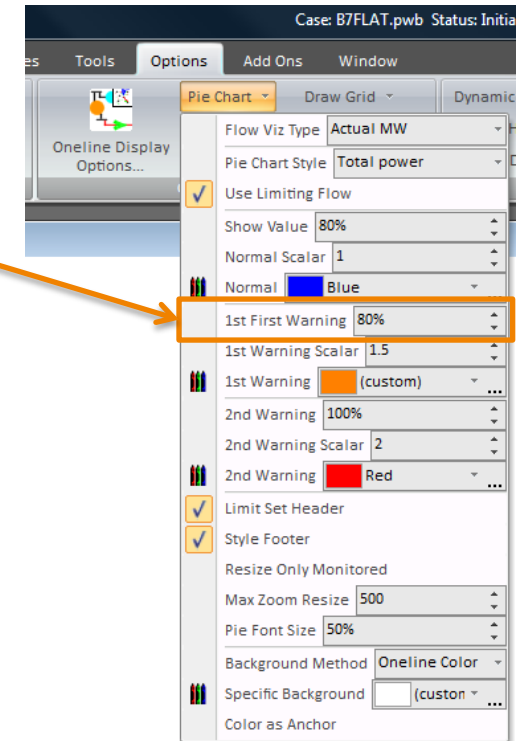

Wide-Area PTDF Visualization

These PTDFs were calculated using a 23,000 bus FERC 715 case for the SERC region

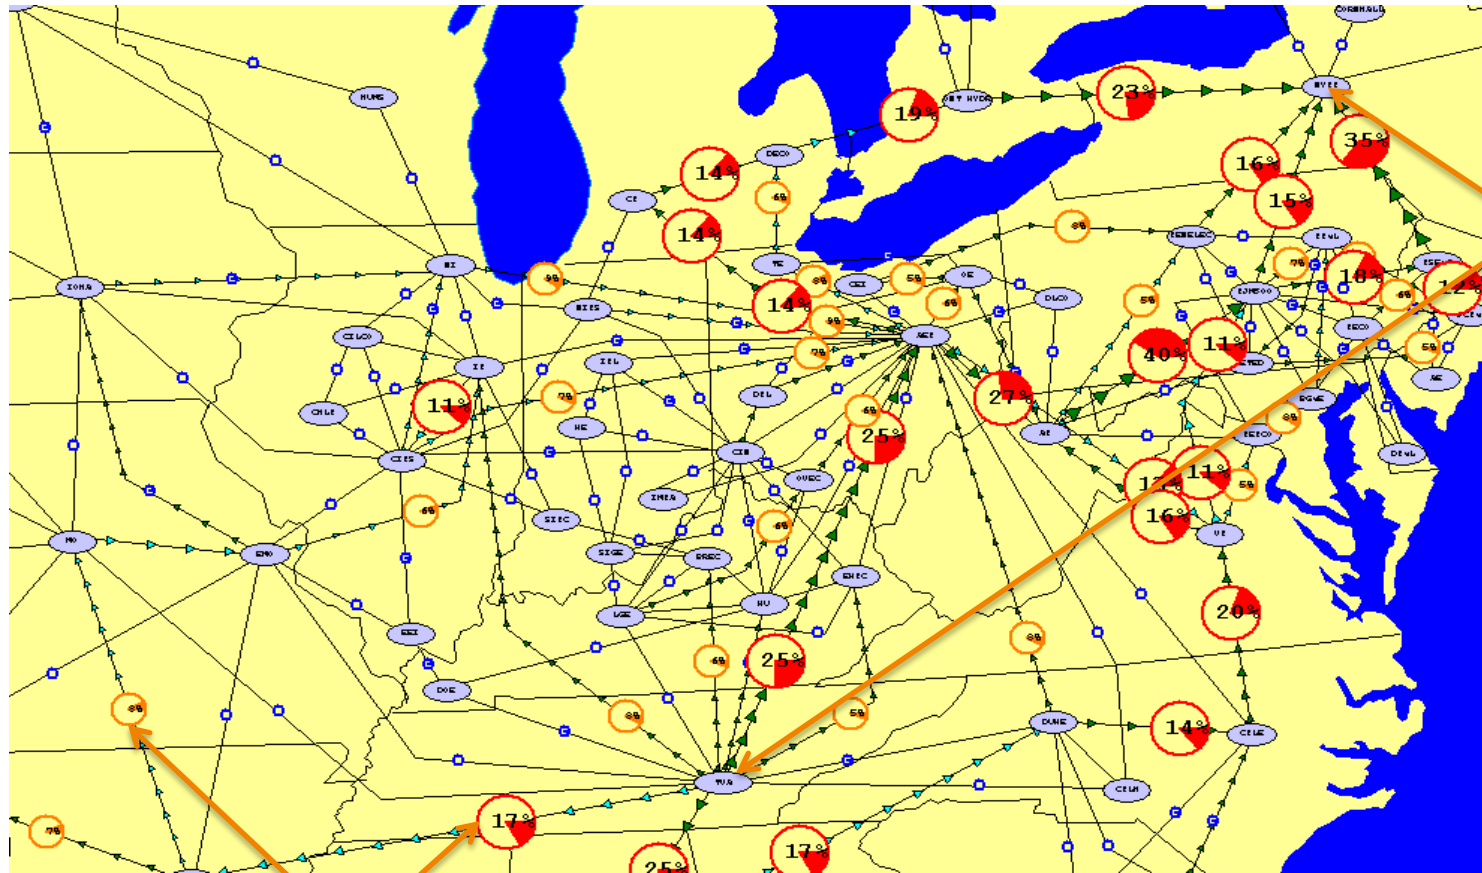

Transfer from TVA to NYPP

Pie charts dynamically change size/color for different PTDF values



Shift Factors



- Sometimes called Generation Shift Factors (GSF) or Transmission Loading Relief (TLR)
- PTDF calculation determines the impact of ONE transfer on MANY lines
- The Shift Factor calculation is exactly the same mathematically, but it determines the impact of MANY transfers on ONE line
- Think about building a table
 - Columns represent many different transfer directions
 - Rows represent many different branches
 - Then the table entry at Row N, Column M is the distribution factor of the Mth transfer on the Nth branch
 - The PTDF calculation determine a column of this table
 - The Shift Factor calculation determines a row of this table

Shift Factor versus PTDFs: Table of Distribution Factors



List of Transfer Directions

List of Lines

	List of Transfer Directions				
	Dir ₁		Dir _N	...	Dir _{n_d}
Line ₁	DF ₁₁	...	DF _{1N}	...	DF _{1n_d}
⋮	⋮	⋱	⋮	⋱	⋮
Line _M	DF _{M1}	...	DF _{MN}	...	DF _{Mn_d}
⋮	⋮	⋱	⋮	⋱	⋮
Line _{n_l}	DF _{n_l1}	...	DF _{n_lN}	...	DF _{n_ln_d}

Shift Factor
Calculation
For Line M

PTDF Calculation for Direction N

Options for Shift Factor Calculation



- Specify a transmission line or interface
- Specify a calculation method (same as for PTDF)
- To narrow down the choices for directions, specify one end of the transfer (buyer or seller)
 - Shift Factor calculates the impact of transferring power between each bus and the specified end of the transfer.
 - The Area Sensitivities determined will just be a weighted average of the sensitivities for each generator bus in the area (weighted by Participation Factors)

Shift Factors Dialog

- Choose **Tools** ribbon tab → **Sensitivities** → **Shift Factors...**

With **Append on Calculate**,
Simulator will retain the
highest distribution factor
calculated for each bus or
area after each calculation

Shift Factors dialog box showing configuration options for PTDF Calculation Method, Shift Factor Sensitivities, and Transactor settings. The 'Append on Calculate' option is selected under Shift Factor Sensitivities.

Number	Name	Area Num	Area Name	P Sensitivity
1	1 One	1 Top		0.030
2	2 Two	1 Top		0.051
3	3 Three	1 Top		-0.054
4	4 Four	1 Top		-0.081
5	5 Five	1 Top		-0.482
6	6 Six	2 Left		-0.082
7	7 Seven	3 Right		-0.349

Calculating the Whole Table: Multiple Direction PTDF



- Simulator also allows you to calculate the entire distribution factor table
- Specify a list of directions
 - Simulator will calculate and display PTDFs for each transfer direction
 - Must be VERY careful. You may ask Simulator to calculate too many numbers for your computer to hold.
 - 20,000 transmission lines and 5000 transfer directions means that you must calculate 100 million values (actually it's 200 million because Simulator calculates the PTDF for both directions of flow on the transmission line)
 - Assuming about 20 bytes per value, that's around 4 GB of computer memory

	Dir ₁		Dir _N	...	Dir _{n_d}
Line ₁	DF ₁₁	...	DF _{1N}	...	DF _{1n_d}
⋮	⋮	⋮	⋮	⋮	⋮
Line _M	DF _{M1}	...	DF _{MN}	...	DF _{Mn_d}
⋮	⋮	⋮	⋮	⋮	⋮
Line _{n_l}	DF _{n_l1}	...	DF _{n_lN}		DF _{n_ln_d}

PTDF Display for Multiple Directions



Choose Multiple Directions

Right-click on list display and choose insert or Auto-Insert to specify directions

To save memory, you can specify whether to store values for only lines or only interfaces

Power Transfer Distribution Factors (PTDFs)

Linear Calculation Method

- ☐ Linearized AC
- ☒ Lossless DC
- ☐ Lossless DC With Phase Shifters

Calculate PTDFs

☐ Automatically recalculate after each power flow

List Display Options

- ☐ Use Area/Zone Filters
- ☒ Store Values For Lines/Transformers
- ☒ Store Values For Interfaces

Calculate MW-Distance

Directions

	Name	Source Name	Sink Name	Include	Processed?
1	Top to Slack	Area Top (1)	Slack	YES	NO
2	Left to Slack	Area Left (2)	Slack	YES	NO
3	Right to Slack	Area Right (3)	Slack	YES	NO

DC Model Options...

Lines/Transformers

	From Number	From Name	To Number	To Name	Circuit	Top to Slack From Top to Slack	Left to Slack From Left to Slack	Right to Slack From Right to Slack
1	1	One	2	Two	1	30.52	-2.10	0.00
2	1	One	3	Three	1	2.81	2.10	0.00
3	2	Two	3	Three	1	-6.42	3.49	0.00
4	2	Two	4	Four	1	-7.02	4.42	0.00
5	2	Two	5	Five	1	34.87	26.66	0.00
6	2	Two	6	Six	1	42.43	-36.67	0.00
7	3	Three	4	Four	1	-3.61	5.59	0.00
8	4	Four	5	Five	1	22.70	10.01	0.00

Help Close

Each column shows PTDF for a different transfer direction.

Calculating the whole Table: Multiple Elements Shift Factors



- Multiple Direction PTDFs work best for
 - A small number of Directions
 - A large number of lines/interfaces
- Multiple Elements Shift Factors work best for
 - A large number of Directions/Buses
 - A small number lines/interfaces

Multiple Elements Shift Factors



- Allows Calculation of Shift Factors for a set of branches or interfaces

Multiple Elements
Select specific elements

Shift Factors with respect
to individual elements

ETLR (Effective TLR or Shift Factor) and
WTLR (Weighted TLR) show sensitivity as a
simple sum and weighted sum, respectively,
of MW relief over all elements in the set

The screenshot shows the 'Shift Factors' window with the following settings:

- Select Device:** Device Type: ☒ Multiple Elements; Lines/XFMRs or Interfaces: ☒ Lines and Transformers; Which Devices: ☒ Contingency-Overloaded Devices.
- Buttons:** 'Select Lines/XFMRs' and 'Select Interfaces' are highlighted with an orange box.
- PTDF Calculation Method:** ☒ Lossless DC.
- Shift Factor Sensitivities:** ☒ Clear before Calculate.
- Disconnected Device Options:** ☒ Do Not Calculate.
- Transactor:** Type: ☒ Buyer; Transactor Object: ☒ Area.
- Sort by:** ☒ Number.
- Buttons:** 'Calculate Shift Factor Sensitivities' is highlighted with an orange box.
- Table:** The 'Buses' tab is selected. The table shows data for 7 buses, with columns for Number, Name, Area Name, ETLR, WTLR, and two sets of shift factors (1 TO 3 CKT 1 and 2 TO 5 CKT 1).

	Number	Name	Area Name	ETLR	WTLR	1 TO 3 CKT 1	2 TO 5 CKT 1
1	1	One	Top	0.1913	0.2302	0.1610	0.0303
2	2	Two	Top	0.0545	0.0402	0.0033	0.0512
3	3	Three	Top	-0.2615	-0.3075	-0.2080	-0.0536
4	4	Four	Top	-0.2458	-0.2705	-0.1643	-0.0815
5	5	Five	Top	-0.5206	-0.3885	-0.0386	-0.4820
6	6	Six	Left	-0.0893	-0.0669	-0.0072	-0.0821
7	7	Seven	Right	-0.3768	-0.2813	-0.0281	-0.3487

ETLR and WTLR Definitions



$$ETLR = \sum_{k=1}^n \alpha_k \theta_k$$

$$WTLR = \frac{n \sum_{k=1}^n \alpha_k \lambda_k \theta_k}{\sum_{k=1}^n \lambda_k}$$

- n = number of elements in calculation
- θ_k = shift factor on element k
- α_k is a direction factor (+1, 0, or -1) and λ_k is a weighting factor
 - Values depend on the choice of the *Which Devices* field on the dialog
 - Details are on the following slide

ETLR and WTLR Parameters (for Branch Elements)



- If *Which Devices* = “Selected Devices”
 - $\alpha_k = +1$ if *MW From* of element k is positive (MW flow is in the reference direction)
= -1 if *MW From* of element k is negative (MW flow is opposite the reference direction)
 - $\lambda_k = \text{Max MVA field of the element}$
- If *Which Devices* = “Overloaded Devices”
 - $\alpha_k = +1$ if *MW From* of element k is positive (MW flow is in the reference direction)
= -1 if *MW From* of element k is negative (MW flow is opposite the reference direction)
 - $\lambda_k = (\% \text{ of MVA Limit (Max)} - \text{Limit Group Branch } \%) * \text{MVA Limit specified by the Normal Rating Set of the Limit Group}$
- If *Which Devices* = “Contingency-Overloaded Devices”
 - $\alpha_k = +1$ if *CTG Loading Direction* is in the reference direction of element k , for all contingencies
= -1 if *CTG Loading Direction* is opposite the reference direction of element k , for all contingencies
= 0 if *CTG Loading Direction* is different for different contingencies
 - $\lambda_k = \text{Aggr MVA Overload on element } k$
- For Interface Elements, substitute MW fields for analogous MVA fields above and Limit Group *Interface %* for Limit Group *Branch %*

Line Outage Distribution Factors (LODFs)



- LODFs are another linearized calculation
 - Calculate the impact of opening (outaging) a transmission branch on all the other branches in the case.
 - Also can calculate the impact of closing in a branch (could call this called a Line Closure Distribution Factor or LCDF)
- Specify a transmission branch, and the calculation determines what percent of the flow on that line will appear on all other transmission lines
 - If the branch was initially open, then the LCDF will calculate what percent of the post-closure flow on the line will appear on other lines

LODF Dialog



- Choose **Tools** ribbon tab → **Sensitivities** → **Line Outage Distribution Factors (LODFs)**

Action will actually be determined for you
(If the line is presently closed, then it will automatically do an outage sensitivity)

Select the transmission branch

Select Calculation Method to Use

	From Number	From Name	To Number	To Name	Circuit	% LODF	MW From	MW To	CTG MW From
1	1 One	2 Two	1	-9.0	59.1	-58.4	52.0		
2	1 One	3 Three	1	9.0	42.8	-41.4	49.9		
3	2 Two	3 Three	1	15.0	37.6	-36.6	49.3		
4	2 Two	4 Four	1	19.0	32.1	-31.5	47.0		
5	2 Two	5 Five	1	-100.0	78.7	-76.4	0.0		
6	2 Two	6 Six	1	57.1	40.1	-39.7	85.0		
7	3 Three	4 Four	1	23.9	-32.0	32.1	-13.1		
8	4 Four	5 Five	1	42.9	14.4	-14.2	-1.1		
9	7 Seven	5 Five	1	57.1	40.1	-39.4	85.0		
10	6 Six	7 Seven	1	28.6	20.0	-19.7	42.5		
11	6 Six	7 Seven	2	28.6	20.0	-19.7	42.5		

LODF values in percent (or LCDF)

Closure Sensitivities

- Closure sensitivity computes % of the estimated post-closure flow on the selected (open) line that will show up on other lines and interfaces.

Calculation based on post-closure or pre-closure flow

Line Outage Distribution Factors (LODFs)

Output Option:
☒ Single LODF
☐ LODF Matrix

Action:
☐ Outage Sensitivities
☒ Closure Sensitivities

Line Closure Options:
Line Status:
☒ Calculate based on post-closure flow (LCDF)
☐ Calculate based on pre-closure flow (MLCDF)

Linear Calculation Method:
☐ Linearized AC
☒ Lossless DC
☐ Lossless DC With Phase Shifters

Buttons: Calculate LODFs, Advanced LODF Calculation, DC Model Options...

Sort by: ☐ Name ☒ Number

Search For Near Bus: 1 (One) [138.0 kV], 2 (Two) [138.0 kV], 3 (Three) [138.0 kV], 4 (Four) [138.0 kV], 5 (Five) [138.0 kV], 6 (Six) [138.0 kV], 7 (Seven) [138.0 kV]

Select Far Bus, CKT: 2 (Two) [138.0 kV] CKT 1, 3 (Three) [138.0 kV] CKT 1

	From Number	From Name	To Number	To Name	Circuit	% LODF	MW From	MW To	CTG MW From	CTG MW To
1	1	One	2	Two	1	-100.0	101.7	-99.8	61.2	-59.2
2	1	One	3	Three	1	0.0	0.0	0.0	0.0	0.0
3	2	Two	3	Three	1	-44.6	56.8	-54.8	38.7	-36.8
4	2	Two	4	Four	1	-35.4	47.5	-46.2	33.2	-31.9
5	2	Two	5	Five	1	-13.3	83.5	-81.0	78.2	-75.6
6	2	Two	6	Six	1	-6.6	42.1	-41.7	39.4	-39.0
7	3	Three	4	Four	1	55.4	-55.2	55.5	-32.7	33.1
8	4	Four	5	Five	1	19.9	5.5	-5.5	13.6	-13.6
9	7	Seven	5	Five	1	-6.6	44.3	-43.5	41.6	-40.9

Buttons: Clear LODF Matrix Results, Help, Close



LODF Matrix



Lines to monitor

Select LODF Matrix

Type of sensitivity

Select lines to outage/close

Select lines to monitor

Lines to outage/close

LODF on Line 2-3 for outage of Line 1-2

Present MW flow on line

	From Number	From Name	To Number	To Name	Circuit	MW From	One (1) TO Two (2) CKT 1	One (1) TO Three (3) CKT 1	Two (2) TO Three (3) CKT 1	Two (2) TO Four (4) CKT 1	Tv
1	1	One	2	Two	1	59.051	-100.00	100.00	-44.65	-35.42	
2	1	One	3	Three	1	42.802	100.00	-100.00	44.65	35.42	
3	2	Two	3	Three	1	37.564	-32.61	32.61	-100.00	43.13	
4	2	Two	4	Four	1	32.118	-25.95	25.95	43.24	-100.00	
5	2	Two	5	Five	1	78.741	-8.98	8.98	14.96	18.95	
6	2	Two	6	Six	1	40.074	-5.71	5.71	9.52	12.06	
7	3	Three	4	Four	1	-31.907	37.50	-37.50	-67.50	64.00	

Outage Transfer Distribution Factors (OTDFs)



- Not a standalone calculation, but used within other Simulator tools
 - Available Transfer Capability (ATC)
 - PTDF for an interface with Contingency Element(s)
 - Contingency Analysis: Calculate OTDFs from PTDFs
- The setup for the calculation
 - Study a transfer between a seller and buyer
 - Monitor the flow on line M
 - What happens after an outage of line C?
- OTDF: the percent of the transfer that will flow on Line M AFTER the outage of line C
- Outage MW (OMW): The MW flow on line M after line C is outaged
- Calculate OMW and OTDF from by using the present flow on the lines and PTDFs and LODFs

OTDF, OMW Calculation



- Values we already know


MW_M = (present MW flow on monitored line M)

MW_C = (present MW flow on contingent line C)

$PTDF_M$ = PTDF for the transfer direction on line M

$PTDF_C$ = PTDF for the transfer direction on line C

$LODF_{M,C}$ = (the percent of flow on line C that will move over to line M if Line C is outaged)

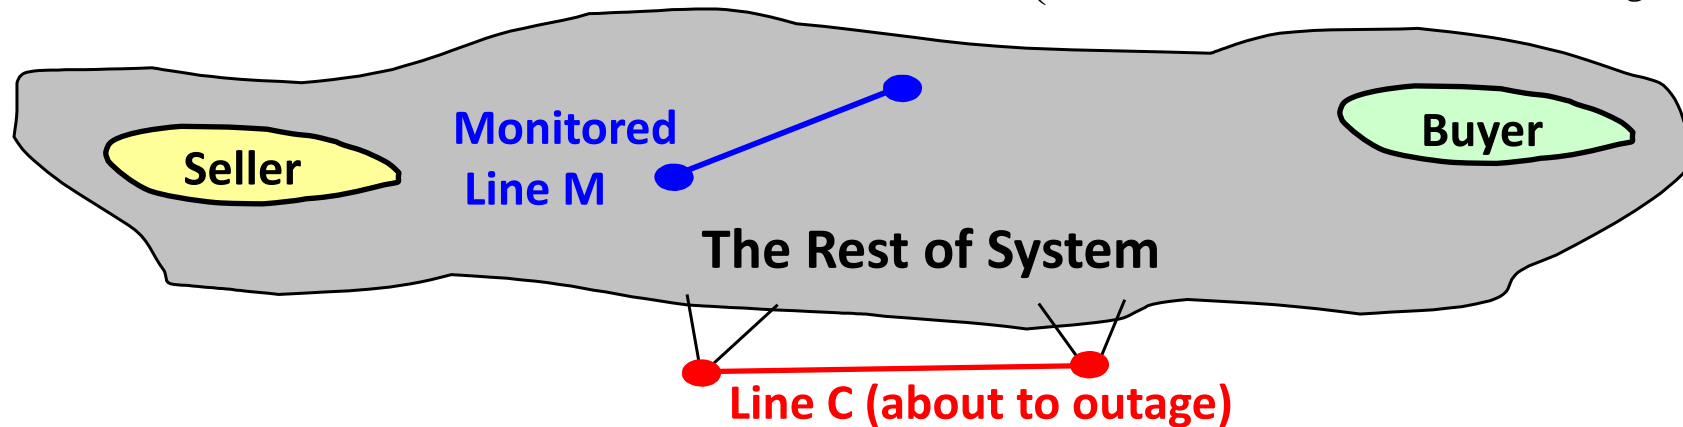

- Calculate the OTDF and OMW values from this

$$OMW_{M,C} = MW_M + LODF_{M,C} * MW_C$$

$$OTDF_{M,C} = PTDF_M + LODF_{M,C} * PTDF_C$$

OTDF and OMW calculation for multiple line outages



- A similar calculation can be done when trying to include multiple-line outage OTDFs
 - Finds the percent of a transfer that will flow on Line M AFTER the outage of lines 1, 2, ...
- Simulator handles these multiple outages internally

Flow and Voltage Sensitivities



- Choose **Tools** ribbon tab → **Sensitivities** → **Flow and Voltage Sensitivities** to bring up the Line Flow/Interface/Bus Sensitivities dialog
- **Single Meter, Multiple Transfers:** Calculates the sensitivity of various values to an injection of real or reactive power, or a change in a regulated bus voltage setpoint
 - If not specified, these calculations assume that the absorption of MW/Mvars occurs at the *island slack bus*

– Line or Interface MW flow sensitivities	→	$\frac{dP_{Flow}}{dP_{injection}}, \frac{dP_{Flow}}{dQ_{injection}}$
– Line or Interface MVAR flow sensitivities	→	$\frac{dQ_{Flow}}{dP_{injection}}, \frac{dQ_{Flow}}{dQ_{injection}}$
– Line or Interface MVA flow sensitivities	→	$\frac{dS_{Flow}}{dP_{injection}}, \frac{dS_{Flow}}{dQ_{injection}}$
– Bus voltage sensitivities	→	$\frac{dV_{Bus}}{dP_{injection}}, \frac{dV_{Bus}}{dQ_{injection}}$
– Generator Mvar sensitivities	→	$\frac{dQ_{Gen}}{dP_{injection}}, \frac{dQ_{Gen}}{dQ_{injection}}$

Flows and Voltage Sensitivities



Select Device and
Flow or Voltage Type

Select Monitored Device

Click Calculate Sensitivities

Number	Name	Area Num	Area Name	P Sensitivity	Q Sensitivity	V Sensitivity
1	1 One	1 Top		0.81569809		-6.03273153
2	2 Two	1 Top		-0.03125550		4.96663284
3	3 Three	1 Top		0.19109720	-0.00265267	
4	4 Four	1 Top		0.14378668		-0.04182116
5	5 Five	1 Top		0.01126089	0.00053437	
6	6 Six	2 Left		-0.02101467		0.01349542
7	7 Seven	3 Right		0.00000000		0.02061643

Represents how the Line 1-2's MW will change for a 1 MW injection of Power at respective bus (with the power absorbed at the slack bus)

Flow and Voltage Sensitivities



- **Self Sensitivity:** sensitivity of voltage at each bus for P or Q injection at that bus (withdrawn at the island slack)

	Number	Name	Nom kV	Area Num	Area Name	dV/dP	dV/dQ	Negative reactance lines	Has closed gen, load or shunts	Likely Alternative Solution (First Neighbors)	PU Volt
1	1	One	138.00	1	Top	0.00000000	0.00000000	NO	YES	NO	1.05001
2	2	Two	138.00	1	Top	0.00000000	0.00000000	NO	YES	NO	1.04000
3	3	Three	138.00	1	Top	0.00008909	0.00023701	NO	YES	NO	0.99269
4	4	Four	138.00	1	Top	0.00000000	0.00000000	NO	YES	NO	1.00000
5	5	Five	138.00	1	Top	0.00012582	0.00034731	NO	YES	NO	1.00665
6	6	Six	138.00	2	Left	0.00000000	0.00000000	NO	YES	NO	1.04000
7	7	Seven	138.00	3	Right	0.00000000	0.00000000	NO	YES	NO	1.04000

dV/dQ is a measure of how close a bus is to QV instability; negative values may indicate a low-voltage solution

Negative dV/dQ is normal if bus is incident to a negative reactance branch (e.g. series capacitor or 3-winding xfr)

Regulated buses usually have zero values

Loss Sensitivities



- Choose **Tools** ribbon tab → **Sensitivities** → **Loss Sensitivities** to bring up the Bus Marginal Loss Sensitivities dialog
- This models an injection of 1.0 MW at a bus with this power being absorbed at the island slack bus
- The **Loss MW Sens** value for each bus represents how much the losses as specified by the **Loss Function Type** will increase for the 1 MW injection at the respective bus

Number	Name	Area Num	Area Name	Loss MW Sens	Penalty Factor	Loss Mvar
1	One	1	Top	0.0604	1.0643	C
2	Two	1	Top	0.0394	1.0410	C
3	Three	1	Top	0.0012	1.0012	-C
4	Four	1	Top	0.0092	1.0093	C
5	Five	1	Top	-0.0170	0.9833	-C
6	Six	2	Left	-0.0064	0.9936	C
7	Seven	3	Right	0.0000	1.0000	C

Loss Sensitivities



- Penalty Factor Column equals $1/(1 - \text{Loss MW Sens})$
- Loss Function Types
 - Do not calculate – All Loss MW Sens values will be zero
 - Each Electrical Island – how do losses change in the island
 - Each Area – For each bus it calculates how the losses in the bus' area will change (Note: this means that sensitivities at buses in two different areas can not be directly compared because they are referenced to different losses)
 - Each Area or Super Area – same as Each Area, but if a Super Area exists it will use this instead (Note: this means that sensitivities at buses in two different areas can not be directly compared because they are referenced to different losses)
 - Areas Selected on Loss Sensitivity Form – Calculates how the losses in the selected areas will change
 - User-Specified – Values will never be recalculated. Also the Loss MW Sens column will become enterable (blue) on the bus displays.



LODF Screening



- Can help identify pairs of contingencies that are significant without actually solving all of the contingencies
- Methods based on the technical paper - C. Matthew Davis and Thomas J. Overbye, "Multiple Element Screening," *IEEE Transactions on Power Systems*, vol. 26, no. 3, pp. 1294-1301, Aug. 2011

LODF Screening

Choose sets of lines to Outage and to Monitor

The screenshot shows the LODF Screening software interface. The 'Lines to Process (Outage)' section has radio buttons for 'All ac Lines', 'Defined Contingencies' (selected), 'Limit Monitoring Settings', 'Use Area/Zone/Owner Filter', 'Use Selected', and 'Meets Filter'. Below these are buttons for 'Select Area/Zone...', 'Select Lines...', and 'Define Filter'. The 'Lines to Monitor' section has similar options, with 'Same as Lines to Process' selected. The 'Options' section includes checkboxes for 'Include Phase Shifters' and 'Include Open Lines' (checked). Below these are input fields for 'LODF Threshold' (70.00) and 'Overload Threshold' (Between 95.00 and 999.00). The 'Calculate' section has a 'Calculate LODFs' button and a progress bar. The 'File Information' section shows the 'File Location' as 'C:\Users\Public\Documents\PowerWorld\22\Sample C'. The 'Summary Information' section shows 'Number of Lines to Process' (11), 'Number of Combinations Without Screening' (55), 'Number of Lines to Monitor' (11), 'Processing Time' (0), and 'Number of CTG Combinations' (27). The 'Summary' table at the bottom has columns: 'Contingency Line', 'Original Contingency Name', 'Highest LOD', 'Highest LODF Line', 'Highest Overload', and 'Highest Overload Line'. The table contains four rows of data, with the second row highlighted in orange.

	Contingency Line	Original Contingency Name	Highest LOD	Highest LODF Line	Highest Overload	Highest Overload Line
1	1 2 1	L_000001One-000002TwoC1	100.00	1 3 1	156.70	1 3 1
2	1 3 1	L_000001One-000003ThreeC1	100.00	1 2 1		
3	2 6 1	L_000002Two-000006SixC1	-100.00	7 5 1	107.87	2 5 1
4	7 5 1	L_000007Seven-000005FiveC1	-100.00	2 6 1	107.87	2 5 1

Optionally use LCDF for Open Lines

Screening thresholds (LODF% and/or Limit%)

Results (columns populated according to options selected above)



Driving Point Impedances

- Compute impedance at each bus, looking into the system

Power Flow Model uses Y-bus; Transient Stability options include internal impedances of generators and loads

	Number	Name	Status	Nom kV	Area Num	Area Name	Driving Point Impedance R	Driving Point Impedance X	Driving Point Impedance Mag	Driving Point Impedance Degrees
1	1	One	Connected	138.00	1	Top	0.0444	0.1301	0.1374	71.17
2	2	Two	Connected	138.00	1	Top	0.0283	0.0827	0.0874	71.11
3	3	Three	Connected	138.00	1	Top	0.0437	0.1280	0.1352	71.14
4	4	Four	Connected	138.00	1	Top	0.0420	0.1231	0.1301	71.15
5	5	Five	Connected	138.00	1	Top	0.0167	0.0495	0.0522	71.36
6	6	Six	Connected	138.00	2	Left	0.0261	0.0771	0.0814	71.26
7	7	Seven	Connected	138.00	3	Right	0.0000	0.0000	0.0000	0.00

Results show R, X, Magnitude, and Angle of impedance from each bus; slack bus is always zero using Power Flow model



Line Loading Replicator



- Available from **Tools** ribbon tab → **Line Loading Replicator**
- Uses linear transfer sensitivities to calculate injection changes required to achieve desired MW flow on a selected line
- Injection groups used to select the generators and loads that can participate in the injection changes
- Net injection change is zero; same amount of MW injected into the system as taken out of the system
- Generator and load min and max always enforced
- Injection changes can be implemented in the power flow case to determine the actual impact of the changes

Line Loading Replicator Dialog



Choose the device

Set the Desired Flow

Participating elements and required injection changes

Implement injection changes in the case

Select the injection group that contains participants

Define Max and Min load limits

MW Flow value that can be achieved on selected device

The dialog box is titled "Line Loading Replicator". It has several sections:

- Select Device:** Includes "Device Type" (Line/XFMR selected), "Present Flow (MW)" (59.051), and "Desired Flow (MW)" (65.051).
- Available Injection Groups:** A list with "INJGRP:0 Area 1" selected.
- Calculation Method:** "Lossless DC" selected.
- Max and Min Load Limits for Injection Changes:** "Use Max and Min Load Values" selected, with "Min Multiplier" and "Max Multiplier" both set to 1.000.
- Injection Changes Table:** A table with columns: Element Type, Bus Number, Bus Name, ID, Distribution Factor, Injection Change MW, Present Injection MW, and New Injection MW. It contains two rows for "Gen" elements.
- Summary:** "Total Injection Increase/Decrease (MW)" is 7.124, and "Flow Achieved (MW)" is 65.051.
- Buttons:** "Implement Injection Changes", "Implement Injection Changes and Solve Power Flow", "Help", and "Close".


Element Type	Bus Number	Bus Name	ID	Distribution Factor	Injection Change MW	Present Injection MW	New Injection MW
1 Gen	1	One	1	0.811	7.124	101.853	108.977
2 Gen	2	Two	1	-0.031	-7.124	170.078	162.954

Tools: Other Ribbon Group

Connections Menu



- Features in this menu analyze the connectivity of the power system model
 - Determine Path Distances to Buses...
 - Determine the path distance at each bus to a particular part of the system
 - Determine Shortest Path Between...
 - Find the shortest path between points in the network
 - Facility Analysis...
 - Find the minimum number of branches to remove to separate two parts of the network
 - Branches that Create Islands...
 - Find a list of branches that if removed will split the network into two islands.

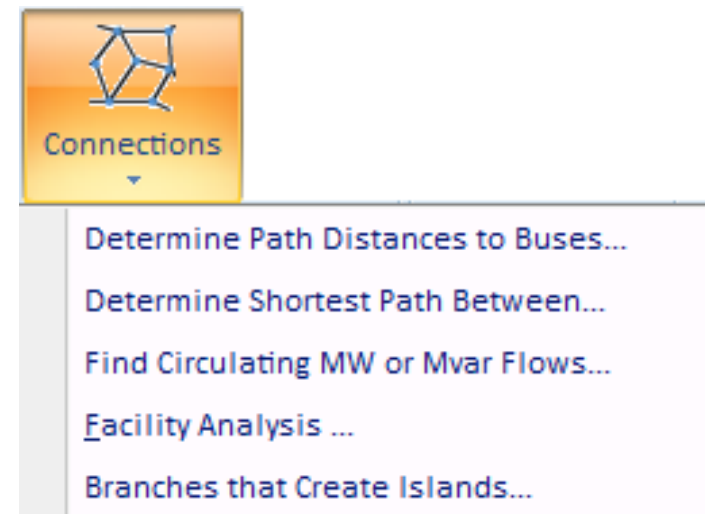


Tools in Connections Menu:


Graph Analysis Tools




Determine
Shortest Path
Between...
Result: Returns
a list of
branches

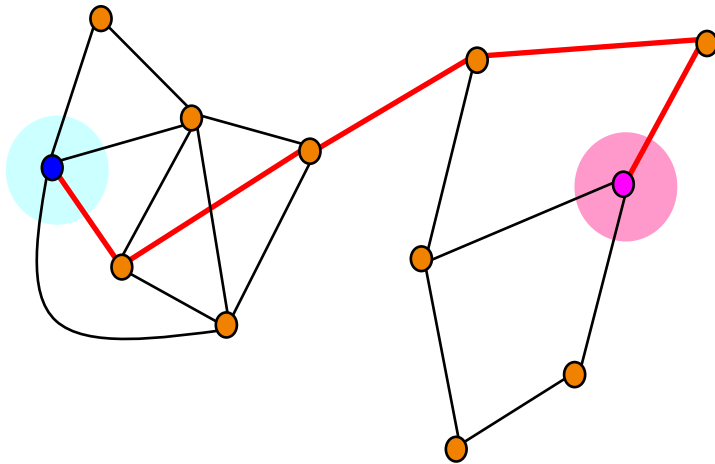


Determine Path
Distances to
Buses...
Result: Labels
every Bus

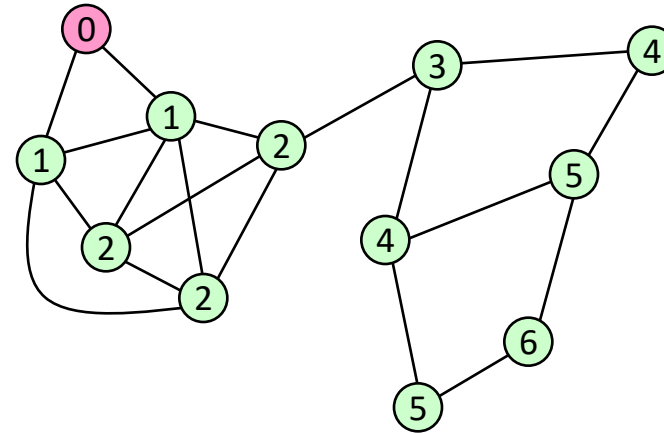

Facility
Analysis...
Result:
Returns a list
of branches

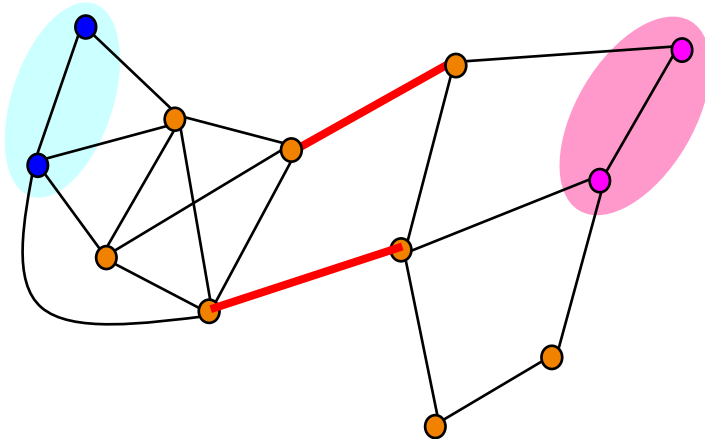

Branches that
Create Islands...
Result: Returns a
list of branches

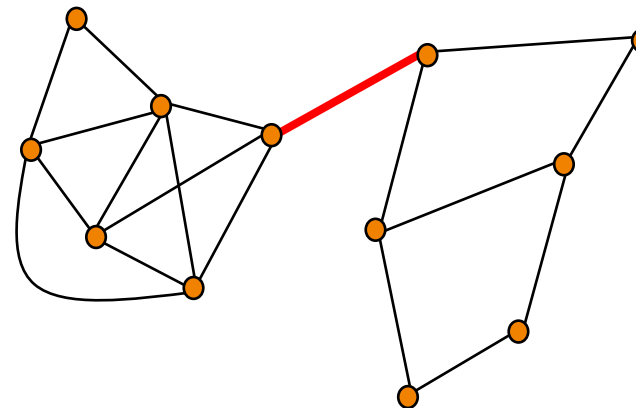

Determine Path Distances From Bus or Group

- This tool allows you to choose a single bus or a group of buses, and then determine the distance from that to all the other buses in the group

Choose “Start” element

Choose “distance”
measure

Specify which paths to consider

Calculate

	Number	Name	Area Name	Zone Name	Nom kV	Cust Float 1
1	1	One	Top	1	138.00	2.000000
2	2	Two	Top	1	138.00	1.000000
3	3	Three	Top	1	138.00	2.000000
4	4	Four	Top	1	138.00	1.000000
5	5	Five	Top	1	138.00	0.000000
6	6	Six	Left	1	138.00	2.000000
7	7	Seven	Right	1	138.00	1.000000

Populate
result to
specified
bus field



Determine Path Distances From Bus or Group Dialog




- Start Group
 - All buses inside this group will be marked with a distance of zero
- Distance Measure
 - Each branch in the network will be treated as having a distance equal to the choice made here
- Lines to Process
 - Specify a filter to limit the branches that can be traversed during this process
- Bus Field to Populate
 - After clicking **Calculate**, the shortest total distance to the Start Group will be calculated for *EVERY* bus in the system.
 - Result of calculation is pasted into this Bus Field and this bus Field is automatically added to the case information display at the bottom

SCRIPT: `DeterminePathDistance([start], BranchDistMeas, BranchFilter, BusField);`

Determine Shortest Path

- This tool generates a list of nodes which has the shortest length to connect the “Start” element to the “End” element

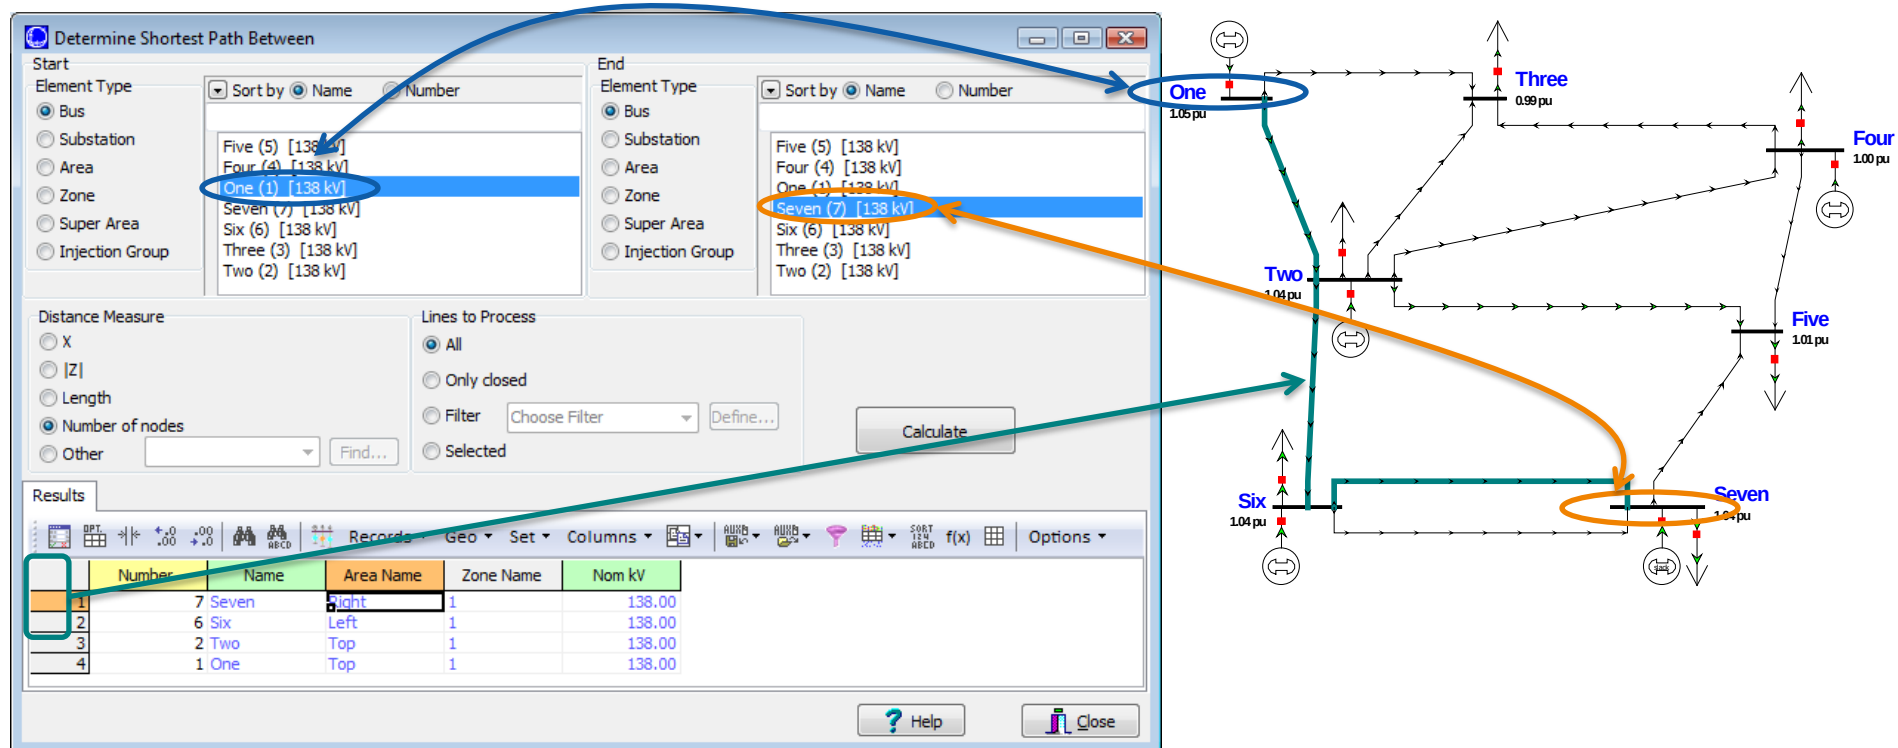

Determine Shortest Path From Bus or Group





- Start Group, End Group
 - Specify a start and end group to determine distances between
- Distance Measure
 - Each branch in the network will be treated as having a distance equal to the choice made here
- Lines to Process
 - Specify a filter to limit the branches that can be traversed during this process
- Click calculate to determine the shortest series of branches that goes from the Start Group to the End Group.

SCRIPT: `DetermineShortestPath([start], [end], BranchDistanceMeasure, BranchFilter, Filename);`

Find Circulating MW or MVA_r Flows

- Circulating power flows in power systems can lead to unnecessary losses and voltage drops
- Flow cycle- A series of branches with positive flows that can be traversed to form a loop
- Common example- Circulating MVAr_s caused by transformers with unbalanced tap ratios

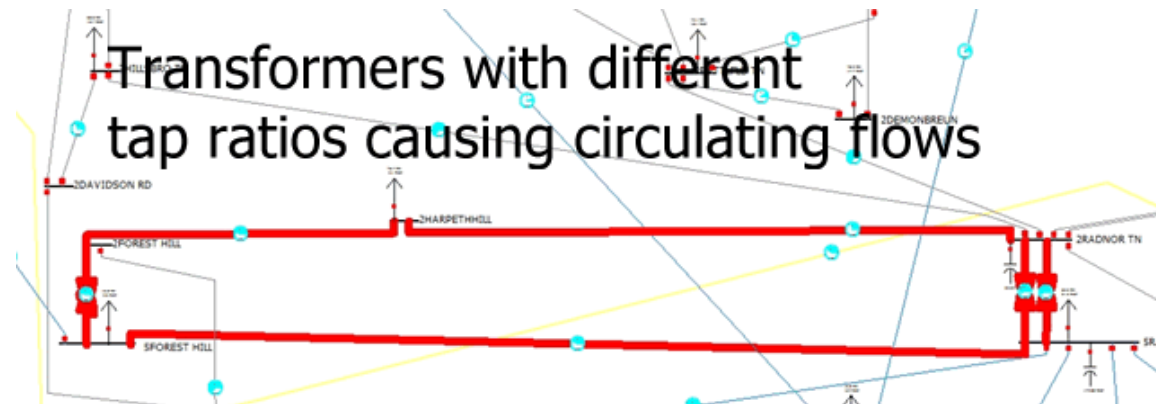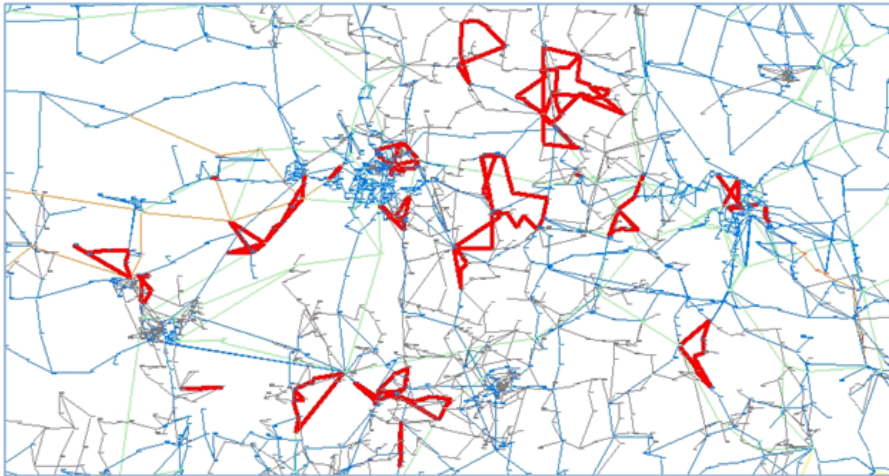

See the PowerWorld help documentation for more details.

Find Circulating MW or MVar Flows



Mvar and MW Flow Cycle Dialog

Find Cycles

Cycle Type to Find
☒ Mvar Cycles
☐ MW Cycles

Flow Threshold: 0.10 Mvar

Maximum Related Cycles: 20

Filter: Advance Flow Cycle Find... Remove

Related Cycle Group	Area Names	Loss Mvar Reduction	Loss MW Reduction	Cycle X-Weighted Ave.	Cycle Min. Flow	Lines in Cycle	Min Bus Num	Max Bus Num	Min Tap
7	7 NYISO	14.06	0.72	85.91	42.64	7	130755	130840	0.
8	2 IESO, NYISO	13.96	0.39	194.23	142.44	6	147834	157063	0.91667
9	2 IESO, NYISO	13.96	0.39	194.22	142.44	6	147834	157063	0.91667
10	2 IESO, NYISO	13.71	0.39	175.18	112.69	7	147834	157063	0.91667
11	2 IESO, NYISO	13.71	0.39	175.18	112.69	7	147834	157063	0.91667
12	2 IESO, NYISO	13.71	0.39	175.18	112.69	7	147834	157063	0.91667

Branches in Selected Flow Cycle

	Near Bus Number	Near Bus Name	Near Bus Nom kV	Far Bus Number	Far Bus Name	Far Bus Nom kV	Circuit	Cycle Flow	Cycle Flow Direction	Loss MW Reduction	Loss Mvar Reduction	Tap Ratio	Phase (Deg)
1	157051	BECK B	345.0	147834	NIAG 345	345.0	1	201.35	From-To	0.00	0.13	1.00000	0.00
2	147834	NIAG 345	345.0	147841	NIAGAR2E	230.0	1	112.69	From-To	0.03	1.40	0.96500	0.00
3	147841	NIAGAR2E	230.0	147842	NIAGAR2W	230.0	1	126.68	To-From	0.00	0.00	1.00000	0.00
4	147842	NIAGAR2W	230.0	157063	BCK2PA27	230.0	1	190.71	To-From	0.24	2.28	1.00000	0.00
5	157063	BCK2PA27	230.0	157052	BECK2 DK	220.0	27	195.86	From-To	0.07	4.93	1.04545	0.00
6	157052	BECK2 DK	220.0	157059	BECK2PA2	220.0	1	231.02	To-From	0.00	0.07	1.00000	0.00
7	157059	BECK2PA2	220.0	157051	BECK B	345.0	02	231.05	From-To	0.03	4.89	0.91667	0.00


Related Cycle- a group of cycles which can all be mutually reached from one another by traversing a series of positive branch flows

Estimate improvements if cycle is removed

Select a cycle to show its elements below



Facility Analysis

- Determine the branches that would isolate the Facility from the External region
- This dialog allows you to choose two sets of buses on the Select the Buses
 - Buses with *Which System?* = EXTERNAL
 - Buses with *Selected?* = YES
- To define the Facility, set *Selected?* = YES and *Which System?* = Study

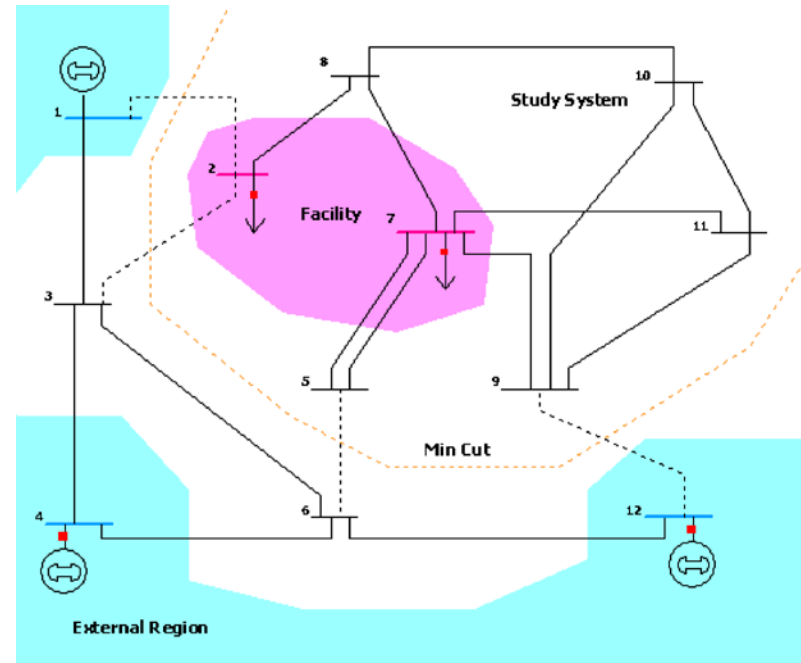


Facility Analysis

When you then switch to the Facility Analysis Tab, you can click **Find Minimum Cut** to find the minimum number of branches to remove to separate the two sets of buses

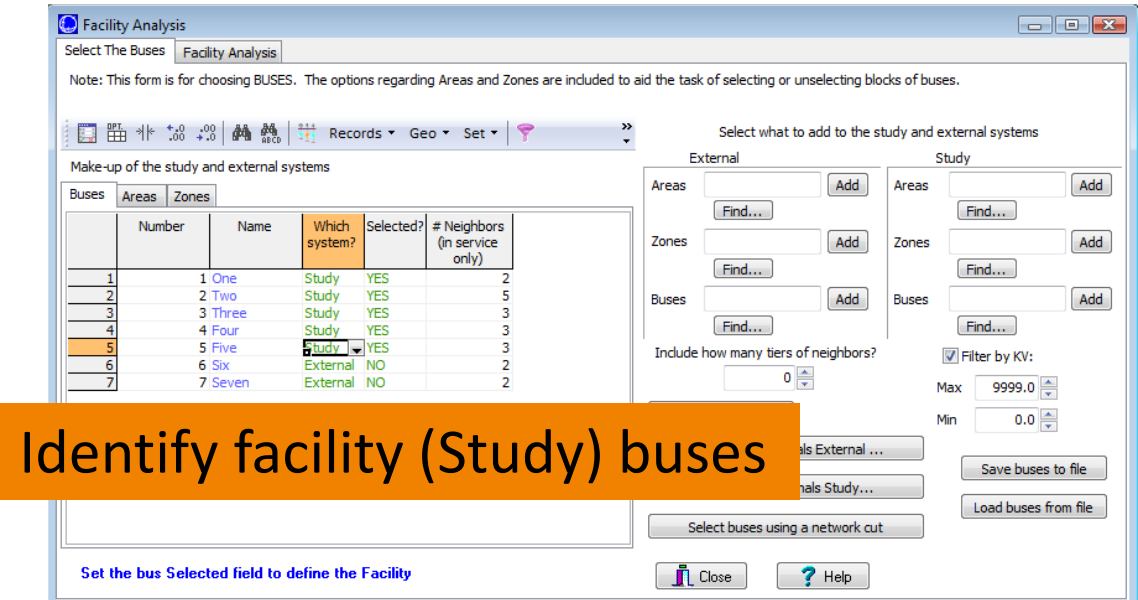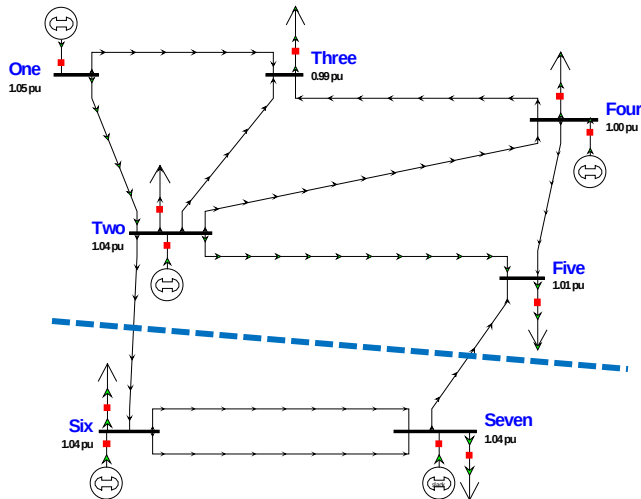

Identify facility (Study) buses

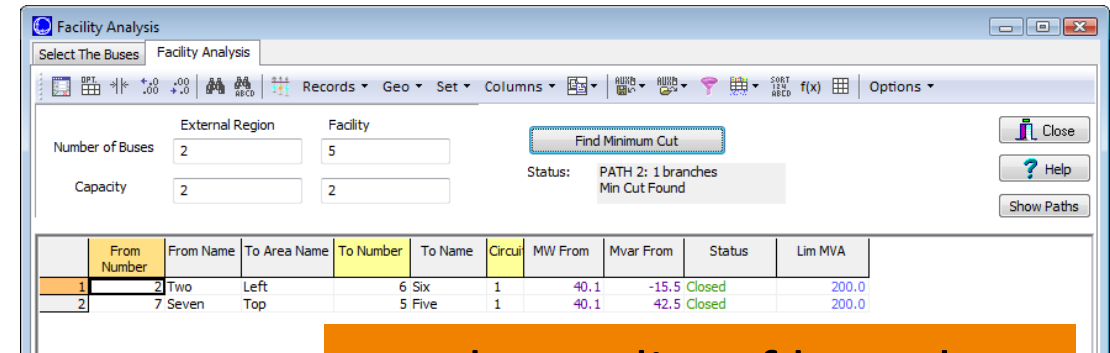

Results – a list of branches





Branches that Create Islands



- Find a list of branches that if removed will split the network into two islands.
- Click **Determine Branches** button to execute.
- Lines to Process
 - Specify a filter to limit the branches that will be checked for creating islands
- Middle part of dialog will list the branches that if opened will create an island
- When you choose a branch from the middle list, the bottom portion of the dialog will list the buses that become islanded as a result of the selected branches outage

Slide Intentionally Left Blank